

An Optimal HVDC Type Study to Increase Wind Power Capacity in Multi-Infeed HVDC Systems

Seungmin Jung¹, Minhan Yoon^{2*}

¹Department of Electrical Engineering, Hanbat National University, Daejeon 305-719, Korea

²Department of Electrical Engineering, Tongmyong University, Busan 48520, Korea

*Corresponding author E-mail: minhan.yoon@gmail.com

Abstract

Background/Objectives: The implementation of renewable energy sources such as wind power generators on power system and the use of DC systems that can compensate for unstable characteristics is increasing.

Methods/Statistical analysis: In this paper, interaction factor criteria among buses for voltage stability criteria inertia criteria analysis for frequency stability are introduced in case that several HVDC converter stations are installed close to each other. The method has estimated a system stability analysis including stability, reliability, and interaction based on the generator constraints. To calculate available renewable energy capacity, power balance combination analysis has been performed.

Findings: Conventional methods for analysis of HVDC system input are generally applied to a single infeed HVDC. In this paper, based on the existing analysis method, we analyze the influence of several and various types of HVDCs on the system and propose must-run generator condition to maintain the stability of the system. Furthermore, the effect on wind power penetration limit was analyzed depending on the combination of HVDC system. The superiority of VSC in multi-infeed HVDC (MIHVDC) system to promote renewable energy implementation could be estimated through the proposed analysis method.

Improvements/Applications: The power system planning and operation including high penetration of renewable energy resources and MIHVDC system would be performed more appropriately.

Keywords: HVDC, LCC, VSC, multi-infeed, wind penetration.

1. Introduction

Recently, the input ratio of renewable energy resources in the power system is rising sharply. These renewable energy resources including wind and photovoltaic cannot be controlled and have high output variability and can adversely affect the frequency and voltage stability of the power system[1]. Therefore, as the penetration rate of new and renewable energy resources increases, additional facilities should be installed to complement the characteristics[2]. A high voltage AC system and HVDC system are mainly two options for bulk power transmission system. HVDC has various advantages over conventional high voltage AC. It is possible to utilize the line efficiently because there is no skin effect and it is less influenced by problems such as insulation considering the peak value. Accordingly, the installation of HVDC transmission systems has been steadily increased globally, which have been installed in the power system to transmit a large capacity power to the long distant and interconnect the power grid between different countries. etc. The widespread HVDC system creates the MIHVDC situation that several converter stations locate closely[3,4].

HVDC can be classified into two types, namely, Line Commutated Converter (LCC) type and Voltage Sourced Converter (VSC) type. Both LCC type and VSC type HVDC have advantages such as long distance transmission, asynchronous grid connection, submarine cable use and power control. For long-distance transmissions, a LCC type with a high voltage level and

low loss is preferred (eg, 1100 kV Ultra HVDC). Although the VSC type has a disadvantage that the capacity is relatively small, the capacity is rapidly increasing due to the development of the power semiconductor device. VSC HVDCs also support reactive power compensation and black start, and help maintain high power quality. It also has advantages of easy connection with offshore wind power and highly concentrated load areas which has a voltage stability problem and has excellent controllability compared to LCCHVDC. Especially, HVDC is widely used for power transmission in asynchronous connection of independent systems such as European super grid[4]. In this case, high controllability of voltage type enables quick response to changes in power transmission amount rapidly.

In a MIHVDC system, the influence on the stability may be different depending on the combination of the LCC type and the VSC type HVDC. As mentioned above, LCC HVDCs have reactive power consumption characteristics and VSC HVDCs can absorb or support reactive power, so it is necessary to take into consideration the influences of each other when they are close to each other and their effect on the system[5],[6]. Voltage stability and frequency stability are representative of the stability index of the system. In order to analyze the system in which HVDC and renewable energy sources are installed, it is necessary to change the stability discrimination method of the existing AC power system. In this study, the stable operation of MIHVDC system to improve wind power penetration rate has been studied.

2. System Description

A MIHVDC system refers to a system in which two or more HVDC converters are electrically connected to each other to exchange real (P_{ij}) and reactive power (Q_{ij}) between them as shown in Figure 1. Due to electrical connection between HVDC, the voltage ($U_{Ln} \angle \delta_n$) of each converter connecting bus line is influenced by each other, which also affects the voltage (U_{dn}) and the current (I_{dn}) of the HVDC system [7].


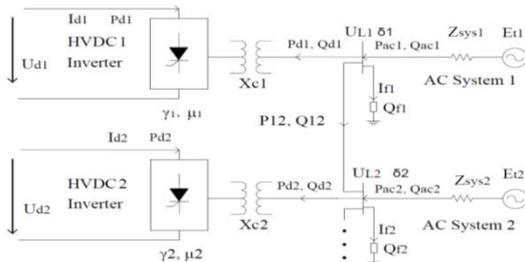


Figure 1: A configuration of the MIHVDC system


2.1. HVDC Type Description

The LCC HVDC system is controlled by the firing timing of the thyristor valves. In other words, since the phase of the alternating current is always behind the voltage reference, reactive power is absolutely necessary to absorb the lagging current. LCC-HVDC, which normally uses a thyristor, should be supplied by the AC system with ground reactive power equivalent to about 50 to 55% of the direct current transmission. Such reactive power consumption can be the reason of a voltage problem according to the HVDC capacity. In the case of a strong interconnection system with a high value of Short Circuit Ratio (SCR), reactive power compensation by capacitors and reactors of an AC filter is generally required to be about 0.6pu of the rated HVDC power transfer capacity. In particular, the LCC HVDC can control AC voltage through the transformer tap adjustment and filter operation according to the amount of electric power. Frequent control of these transformer taps and filters can result in large and small fluctuations in the grid [3].

The VSC HVDC, which can solve the reactive power compensation problem of LCC HVDC transmission system, power flow control performance and quality since semiconductor switching devices that can freely control switching on and off of GTO, IGBT, IGCT, etc. By controlling the phase angle of voltage and current using energy stored in DC capacitor, real power and reactive power is able to be controlled independently. Despite the economics and the converter loss, operation technology for high control performance can support the flexible power system operation. In Figure 2, in case of VSC HVDC, the direction of the power flow can be controlled by Id control without a separate sequence. DC voltage polarity has not required to be reversed. On the other hand, in the case of the LCC HVDC, there exists a region where the voltage cannot be controlled, typically + 10% to -10%, and has a characteristic in which the direction of electric power is changed through switching of the voltage polarity [3, 4].

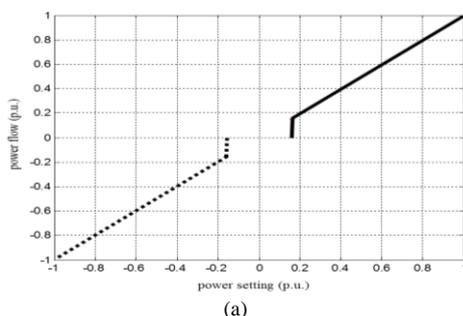

(a)

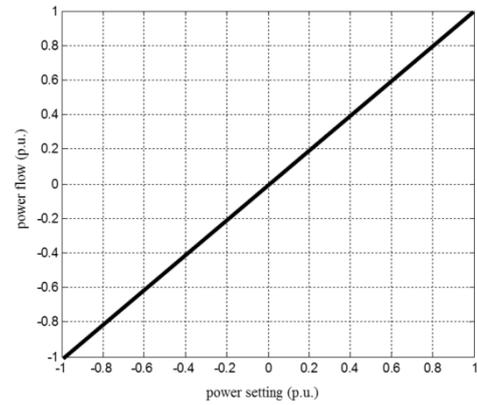

(b)

Figure 2: Power flow curve of (a) LCC (b) VSC HVDC

2.2. MIESCR Analysis

Short Circuit Ratio (SCR) is criteria that takes into account the strength of the system. When operating an HVDC system with a small Effective Short Circuit Ratio (ESCR) value, the AC voltage of the converter bus is likely to become unstable status such as overvoltage, under-voltage, or voltage oscillation. Therefore, the possibility of the commutation failure is increased [8]. Generally, if the ESCR is greater than 3, it is considered to be connected to the stronger AC system and, if less than 2, to the weaker AC system. ESCR can be expanded and applied to the MIHVDC system. A Multi-Infed Interaction Factor (MIIF) is a factor indicating how much the other j-th bus voltage when a voltage change occurs on specified i-th bus. The MIIF value increases when the electrical distance between the two buses is short.

Multi-Infed Interaction Factor

$$MIIF_{i,j} = \frac{\Delta V_j}{1\% \text{ change in } V_i} \quad (1)$$

Multi-Infed Interaction Effective Short Circuit Ratio

$$MIESCR_i = \frac{SCC_i - Q_{ci}}{P_{di} + \sum_{j=1, j \neq i}^N P_{dj} \times MIIF_{i,j}} \quad (2)$$

2.3. Effective Inertia Analysis

The Effective Inertia Constant is the ability to support the AC system frequency by the rotational inertia of the machines. [9]. According to IEEE Standard 1204-1997, Hdc is required to be 2.0 or more for stable operation of HVDC. In general, there are the following cases that can cause system frequency reduction. HVDC commutation failure (simultaneous current failures should be considered between buses with a MIIF greater than 0.6), accidents at the HVDC transmission line or front end, and DC line accident. If we suppose to keep the frequency fluctuation within 5% when you supply the system with HVDC due to system accident, which is the harshest situation, and then return from the system accident after 0.2 seconds after all the system is dropped.

$$H_{dc} = \frac{p \times dt \times f_0}{2df} = \frac{1 \times 0.2 \times 1}{2 \times 0.05} = 2$$

$$= \frac{MVA \text{ rating of the machine}}{MW \text{ rating of the dc system}} \quad (3)$$

3. Simulation

3.1. Target System

As shown in Figure 3, #1 HVDC transmission system was

installed between Haenam and Jeju island in 1998, which is the first HVDC system furnished in Korea. and has been operated. The construction of additional HVDC transmission system between mainland and the Jeju island has been currently underway to cope with recent changes of the power market of the Jeju island, for examples the increase of power demand and the capacity of wind power generation. etc. #2 HVDC transmission system construction completed in 2014 and #3 HVDC will be installed in near future. The Jeju power system will be operated with multiple HVDC system connecting mainland[10]. In Figure 4, #1 HVDC is for unidirectional power flow from mainland to Jeju island. #2 HVDC has a Simultaneous Bidirectional Power Flow Control (SBPFC) functionality and support reversal power flow from Jeju island to mainland. #3 HVDC is assumed that would be LCC type with an SBPFC functionality or VSC type which has continuous operating area.

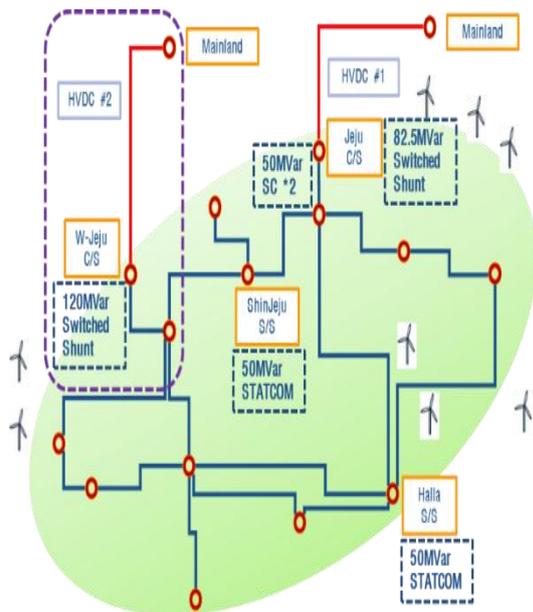


Figure 3: Schematic diagram of Jeju island

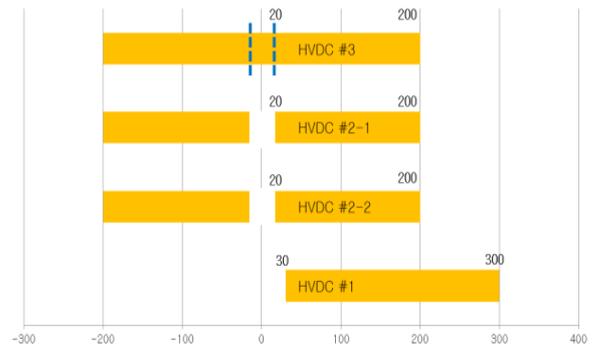


Figure 4: Operating region of Jeju HVDC systems

Table 1 summarizes the MIIF at off peak load and peak load of Jeju system. In general, MIIF appears larger at off-peak loads and smaller at peak loads. In this study, MIESCR was considered based on the higher values of MIIF in more severe conditions, ie, the Jeju C/S and Jeju C/S buses. In the MIESCR review, the scenario of the generator operation was considered from case 1 where only Jeju internal combustion engine starts to case 9 which is the case of all generator startup scenario. The MIESCR review was conducted for 400MW and 200MW based on 600MW of maximum HVDC operation.

Table 1: Power system information for Jeju island

	Peak Case		Off-Peak Case	
	Jeju C/S	Seojeju C/S	Jeju C/S	Seojeju C/S
Voltage fluctuation	1	1.0003	1	1.01167
MIIF _{Jeju, seojeju}	0.99	0.9924	0.99	1.0031
MIIF _{Jeju, seojeju}	0.79		0.857	
Voltage fluctuation	1.0147	1	1.0203	1
MIIF _{seojeju, jeju}	1.0079	0.99	1.0115	0.99
MIIF _{seojeju, jeju}	0.68		0.88	

The must-run generator scenario in Jeju power system can be organized as shown in Table 2. Depending on the combination of generators in service, the short circuit level of the system also changes. As shown in Table 2, if the generator with high MVA rating is turned on a lot, the short circuit capacity of the system also becomes large.

Table 2: Jeju system generator must-run scenario and short circuit capacity

Gen	Rating	Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7	Case 8	Case 9
Jeju DP #1	40	ON								
Jeju DP #2	40	ON			ON	ON	ON	ON	ON	ON
S-Jeju TP #3	100		ON		ON		ON	ON	ON	ON
S-Jeju TP #4	100						ON		ON	ON
Jeju TP #2	75			ON		ON		ON	ON	ON
Jeju TP #3	75									ON
SCC _{Jeju C/S} [MVA]		586.99	916.14	838.3	1018.6	941.3	1268.9	1371.2	1618.9	1958.9
SCC _{Seojeju} [MVA]		528.59	876	725.42	957.66	800.48	1239	1218.5	1497.7	1714.3

HVDC # 1 and # 2 operation points were used as existing operation points (#1 : 150MW, #2 : 250MW) and HVDC # 3 200MW operation condition was examined. In case of LCC HVDC installation, MIESCR condition was satisfied from Case 8, and MIESCR condition was satisfied from Case 4 in case of VSC HVDC installation as shown in Table 3. In other words, it means that the Jeju system including MIHVDC system can be operated stably if the must-run generator that satisfies the minimum MIESCR value required for each type is turned on. Since the

HVDC can supply more than 90% of off-peak to 600MW out of the total 757MW load at the peak after the # 3 HVDC injection after the # 3 HVDC injection, there is a margin to the inertia constant and the standard value recommended by the IEEE 2.0. Respectively. In conclusion, Case 1 and Case 3 violate the conditions as shown in Table 4. In order to maintain the system frequency stable, the must run generator must be turned on more than the scenario.

Table 3: MIESCR depending on the HVDC type

MIESCR_LCC	Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7	Case 8	Case 9
Jeju C/S	0.6652	1.2569	1.1151	1.4322	1.2923	1.9875	2.0594	2.6144	3.2509
Seojeju C/S	0.6904	1.3268	1.0599	1.4738	1.1944	2.0844	1.9576	2.5524	2.974
MIESCR_VSC	Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7	Case 8	Case 9
Jeju C/S	1.349	2.2606	2.0422	2.5307	2.3152	3.3862	3.497	4.3519	5.3324
Seojeju C/S	1.0031	1.9275	1.5397	2.1411	1.7353	3.0282	2.8439	3.708	4.3205

Table 4: Effective inertia depending on must-run generator combination

	Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7	Case 8	Case 9
H_{ac}	961.76	1430.98	1184.21	1732.66	1485.89	2503.56	2256.79	3027.69	3551.81
H_{dc}	1.60	2.38	1.97	2.89	2.48	4.17	3.76	5.05	5.92

3.2. Wind Power Penetration Limit

All of the above considerations were carried out in consideration of various scenario. As a result of examining the stability index condition, when the HVDC 3 phase is put into the LCC HVDC, the peak load (757MW) is operated with the generator condition of Case 8 or more under the maximum operating condition. However, in case of the VSC HVDC, there is no violation in the above two examinations from Case 4 and above, and it can be said that stable operation is possible in Case 2 considering the self-voltage control ability of the VSC type.

$$P_{gen.must} = \text{Max}(Gen_{eser}, Gen_{hdc}) \quad (4)$$

Based on the above reviews, the wind power threshold can be defined by must-run generator constraints. In case of HVDC 1, only uni-directional transmission from land to Jeju is considered. In case of Units 2 and 3, Automatic Frequency Control (AFC), SBPFC. It is assumed that the operation area is bidirectional maximum 200 MW. Wind power generation fluctuation, and Jeju system accident problem. However, HVDC can cope with HVDC easily because HVDC can perform high frequency operation in the entire operation range of -370MW ~ 600MW. As shown in Table 5, an available wind power generation capacity has been estimated by power balance of the jeju system using equation (5) and (6) [11].

$$P_{load} = P_{dc\#1} + P_{dc\#2} + P_{gen.must} + P_{wind} + P_{dc\#3} \quad (5)$$

$$P_{wind} = P_{load} - \sum P_{dc} - P_{gen.must} \quad (6)$$

Table 5: Wind capacity growth prediction for Jeju island

Gen	Rating	LCC(Case4)	VSC(Case8)
Jeju DP#1	40	ON	ON
Jeju DP#2	40	ON	ON
S-Jeju TP#3	100	ON	ON
S-Jeju TP#4	100		ON
Jeju TP#2	75		ON
Jeju TP#3	75		
$P_{gen.must}$		60	140
$P_{wind.peak}$		1067	987
$P_{wind.offpeak}$		703	623

4. Conclusion

In this paper, the modeling of the HVDC system in Jeju island which can reflect stability constraints is performed. An analysis method and operation strategy for the stable operation of different types of multi-infeed HVDC system are proposed. Based on the propose method, the optimal operation strategies of the HVDC systems between the mainland of Korea and the Jeju are suggested to ensure the power system stability. The simulation results show that VSC HVDC requires fewer must-run generator compared to LCC HVDC. Therefore, VSC HVDC can promote more renewable energy implementation to match the power balance of supply and demand. In the future, optimal operation point selection an economic comparison for the several objectives can be performed based on the result.

Acknowledgment

This work was supported by Tongmyong University Research Grants(2018F048), and National Research Foundation Grant(2017R1C1B5018073) funded by the Korean government.

References

- [1] Carrasco, J. M., Franquelo, L. G., Bialasiewicz, J. T., Galván, E., PortilloGuisado, R. C., Prats, M. M., ...& Moreno-Alfonso, N. (2006). Power-electronic systems for the grid integration of renewable energy sources: A survey. *IEEE Trans. Industrial Electronics*, 53(4), 1002-1016.
- [2] Singh, M., Khadkikar, V., Chandra, A., & Varma, R. K. (2011). Grid interconnection of renewable energy sources at the distribution level with power-quality improvement features. *IEEE Trans. Power Delivery*, 26(1), 307-315.
- [3] Arrillaga, J., Liu, Y. H., & Watson, N. R. (2007). *Flexible power transmission: the HVDC options*. John Wiley & Sons.
- [4] Flourentzou, N., Agelidis, V. G., & Demetriades, G. D. (2009). VSC-based HVDC power transmission systems: An overview. *IEEE Trans. Power Electronics*, 24(3), 592-602.
- [5] Aik, D. L. H., & Andersson, G. (1997). Voltage stability analysis of multi-infeed HVDC systems. *IEEE Trans. Power Delivery*, 12(3), 1309-1318.
- [6] Aik, D. L. H., & Andersson, G. (1998). Power stability analysis of multi-infeed HVDC systems. *IEEE Trans. Power Delivery*, 13(3), 923-931.
- [7] Guo, C., Zhang, Y., Gole, A. M., & Zhao, C. (2012). Analysis of dual-infeed HVDC with LCC-HVDC and VSC-HVDC. *IEEE Trans. Power Delivery*, 27(3), 1529-1537.
- [8] Ni, X., Gole, A. M., Zhao, C., & Guo, C. (2018). An improved measure of AC system strength for performance analysis of multi-infeed HVdc systems including VSC and LCC converters. *IEEE Trans. Power Delivery*, 33(1), 169-178.
- [9] Nayak, O. B., Gole, A. M., Chapman, D. G., & Davies, J. B. (1994). Dynamic performance of static and synchronous compensators at an HVDC inverter bus in a very weak AC system. *IEEE Tran. Power Systems*, 9(3), 1350-1358.
- [10] Shin, B., Yoon, M., Suh, J., & Jang, G. (2014, Sep). A Study on Jeju Power System Considering Smart Grid Elements. *Journal of International Council on Electrical Engineering*, 3(4), 300-305.
- [11] De Jonghe, C., Delarue, E., Belmans, R., & D'haeseleer, W. (2011). Determining optimal electricity technology mix with high level of wind power penetration. *Applied Energy*, 88(6), 2231-2238.