

Synthesis and control of UPFC system using PI-D and (NEWELM and NIMC) based adaptive control for compensation power in transmission line

Bouanane Abdelkrim^{1*}, Yahiaoui Merzoug¹, Benyahia Khaled¹ Chaker Abdelkader²

¹ Electrotechnical Engineering Laboratory, Electrical Engineering Department, Faculty of Technology, Dr. Moulay Taher University of SAIDA, BP 138, En-Nasr, SAIDA 20000, Algeria

² SCARME Laboratory, Electrical Engineering Department, ENP- ORAN, ORAN 31000, Algeria

*Corresponding author E-mail: bouananeabd@yahoo.fr

Abstract

Flexible Alternating Current Transmission System devices (FACTS) are power electronic components. Their fast response offers potential benefits for power system stability enhancement and allows utilities to operate their transmission systems even closer to their physical limitations, more efficiently, with improved reliability, greater stability and security than traditional mechanical switching technology. The unified Power Flow Controller (UPFC) is the most comprehensive multivariable device among the FACTS controllers. According to high importance of power flow control in transmission lines, new controllers are designed based on the Elman Recurrent Neural Network (NEWELM) and Neural Inverse Model Control (NIMC) with adaptive control. The Main purpose of this paper is to design a controller which enables a power system to track reference signals precisely and to be robust in the presence of uncertainty of system parameters and disturbances. The performances of the proposed controllers (NEWELM and NIMC) are based neural adaptive control and simulated on a two-bus test system and compared with a conventional PI controller with decoupling (PI-D). The studies are performed based on well-known software package MATLAB/Simulink tool box.

Keywords: FACTS; UPFC; PI-D; NEWELM; NIMC; Neural Adaptive Control; Synthesis; Stability; Robustness.

1. Introduction

The industrialization and the growth of the population are the first factors for which the consumption of electrical energy increases regularly. In addition we live today in the era of electronics and informatics and any expenses are very sensitive to disturbances that occur on their supplies: a loss of power can cause the interruption of the different processes of the production; and in front of consumers who are becoming more demanding in wanting more energy and best quality, enterprises of production of electrical energy must therefore ensure the regular supply of this request, and without interruption, through a mesh network and interconnected in order to prove a reliability in their service; and increase the number of power plants, lines, transformers etc., which implies an increase of the cost and the degradation of the natural environment (L.Gyugyi, 1994). The networks increased continuously and they become complex and more difficult to control. This system must drive in large quantities of energy in the absence of control devices and sophisticated adequate, a lot of problems can occur on this network such as: the transit of the reactive power in excess in the lines, the hollow of voltage between different parts of the network... etc. and this fact the potential of the interconnection of the network will not operate properly. Up to the end of the eighties, the electrical networks were controlled by electromechanical devices having a response time of the more or less long, coils of inductance and capacitors switched by circuit breakers for the maintenance of the voltage and the management of the reagent (Praing and al, 2000). However, problems of wear as well as their slow action does not allow to operate these

devices more than a few times a day, they are therefore difficult to use for a continuous control of the flow of power. Another technique of adjustment and control of reactive powers, tensions and transits of power using the power electronics has made its evidence. The solution of these problems happening by improving the control of electrical systems is already in place. It is necessary to equip these systems with a certain degree of flexibility allowing them to better adapt to the new requirements. The rapid development of the power electronics has had a considerable effect in the improvement of the conditions for the functioning of the electrical networks in the performance of the control of their settings by the introduction of control devices on the basis of components of Power Electronics very advanced (GTO, IGBT) known under the acronym FACTS: "flexible alternating current transmission systems" (Renz and al, 1999; Gyeonggi and al 2008; Johal and al 2007). The contribution of this technology "FACTS" (Narain G. H. and al 1999) for the companies of the electricity is to open new prospects for controlling the flow of power in networks and to increase the capacity used existing lines similar to extensions in the latter. The UPFC consists of two voltage-source inverters with fully switchable elements (GTO, IGBT) that are connected through a common continuous link (DC-link). One, connected in shunt, called STATCOM (Static compensator), and injects an almost sinusoidal current of adjustable magnitude. The second, connected in series, called SSSC (Static Series synchronous compensator) (Sen and al 1998; Mathur and al, 2002), injects in series an almost alternative voltage with an adjustable amplitude and phase angle in the transport line. Each inverter can swap the necessary reactive power locally, and produce the active power as a result of the serial injection of a

voltage. The basic function of the shunt inverter (Inverter 1) is to supply or absorb the active power requested by the serial inverter (Inverter 2) through the common DC connection. It can also produce or absorb reactive power as required and provide voltage support at the network connection point.

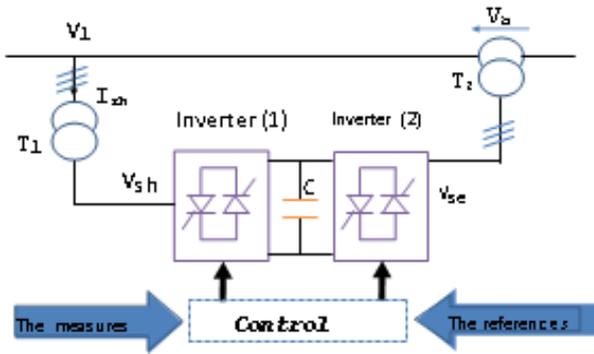


Fig. 1: Basic Circuit Configuration of A UPFC.

2. Modeling of a UPFC system

The equivalent circuit of a UPFC system is shown in Fig. 2 where the series and shunt inverters are represented by voltage sources v_c and v_p respectively. The transmission line is modelled (Jagtab and al, 2010; Zhengyu and al 2000; Bouanane and al, 2013) as a series combination of resistance r and inductance L . The parameters r_p and L_p represent the shunt transformer resistance and leakage inductance respectively. The non-linearity's caused by the switching of the semiconductor devices, transformer saturation and controller time delays are neglected in the equivalent circuit and it is assumed that the transmission system is symmetrical. The simplified circuit of the UPFC control and compensation system is shown in Figure 2.

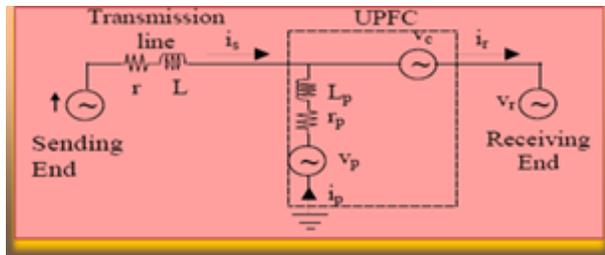


Fig. 2: Equivalent Circuit of UPFC System.

The modelling of this circuit is based on hypotheses simplifying. The dynamic equations of the UPFC are divided into three systems of equations. By performing PARK transformation, the current through the transmission line can be described by the following equations:

$$\begin{cases} \frac{di_{sd}}{dt} = \omega i_{sq} - \frac{r}{L} i_{sd} + \frac{1}{L} (v_{sd} - v_{cd} - v_{rd}) \\ \frac{di_{sq}}{dt} = -\omega i_{sd} - \frac{r}{L} i_{sq} + \frac{1}{L} (v_{sq} - v_{cq} - v_{rq}) \end{cases} \quad (1)$$

Similarly, the shunt inverter can be described by:

$$\begin{cases} \frac{di_{pd}}{dt} = \omega i_{pq} \frac{r_p}{L_p} i_{pd} + \frac{1}{L_p} (v_{pd} - v_{cd} - v_{rd}) \\ \frac{di_{pq}}{dt} = -\omega i_{pd} \frac{r_p}{L_p} i_{pq} + \frac{1}{L_p} (v_{pq} - v_{cq} - v_{rq}) \end{cases} \quad (2)$$

By the use of power balance if one neglects the losses of the inverter it is possible to express the continuous voltage by:

$$\frac{dv_c}{dt} = \frac{3}{2Cv_c} (V_{cd}i_{rd} + V_{cq}i_{rq} - V_{pd}i_{pd} - V_{pq}i_{pq}) \quad (3)$$

The DC-link capacitor C must be selected to be large enough to minimize voltage transients.

3. Controller design

The control system of the UPFC consists of the shunt inverter with the control circuit (Papic and al, 1997; Hideak and al 1999; Kannan and al 2007), as well as the series inverter. First, we justify the possibility of separation of the two control circuits and similarly we are interested in the adjustment of the inverter for the additional voltage and more particularly to the setting of the active and reactive power transmitted.

Then we will develop the different settings considered in this study and we will show the transient behaviour of the control circuits using a simulation of the regulators considered in the adjustment of the closed loop UPFC system in order to improve the performances in the case of active or reactive power change, (change one of the three parameters of the line).

3.1. PI decoupling control (PI-D)

The objective of using the UPFC system is to provide independent control of active P and reactive Q power flow in the system for fixed values of V_s and V_r . This can be achieved by properly controlling the series injected voltage of the UPFC. The voltage, current and power flow are related through the equations missing?

The principle of this control strategy is to convert the measured three phase currents and voltages into d-q values and then to calculate the current references and measured voltages as follow:

$$P = \frac{3}{2} (v_{sd}i_{sd} + v_{sq}i_{sq}) \quad (4)$$

$$Q = \frac{3}{2} (v_{sd}i_{sq} - v_{sq}i_{sd}) \quad (5)$$

With $i_{rd} = i_{sd} + i_{pd}$ and $i_{rq} = i_{sq} + i_{pq}$

$$i_d^* = \frac{2}{3} \left(\frac{P^* v_{sd} - Q^* v_{sq}}{\Delta} \right) \quad (6)$$

$$i_q^* = \frac{2}{3} \left(\frac{P^* v_{sq} - Q^* v_{sd}}{\Delta} \right) \quad (7)$$

$$\text{With: } \Delta = V_{sd}^2 + V_{sq}^2 \quad (8)$$

According to the system of equations (1) or (2), one can have the system contains a coupling between the reactive and active current I_d, I_q . The interaction between current caused by the coupling term (ω) Fig. 3.

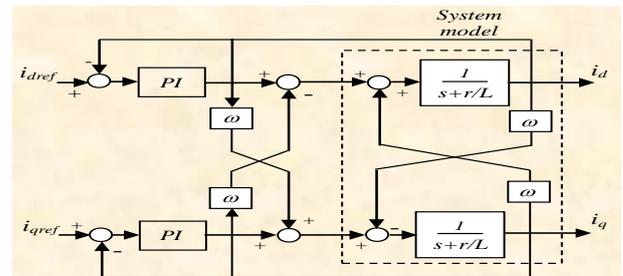


Fig. 3: Control Design with PI Corrector.

To be able to lead to a reliable command of the system, it is indispensable to proceed to a decoupling of the two components. The decoupling of two loops is obtained by subtracting the term (ω) through a reaction against.

It is then conducted to a rule which provides a command with decoupling (PI-D) of the currents I_d and I_q with a model which can be rewritten in the following form:

$$\begin{cases} \frac{di_{sd}}{dt} = \omega(1 - \epsilon)i_{sq} - \frac{r}{L}i_{sd} + \frac{1}{L}(v_{sd} - v_{cd} - v_{rd}) \\ \frac{di_{sq}}{dt} = \omega(1 - \epsilon)i_{sd} - \frac{r}{L}i_{sq} + \frac{1}{L}(v_{sd} - v_{cd} - v_{rd}) \end{cases} \quad (9)$$

The design of the control system must begin with the selection of variables to adjust and then that of the control variables and their association with variables set. There are various adjustment techniques well suited to the PI controller.

The structure of the PI controller is represented by the first block diagram of Figure 4.

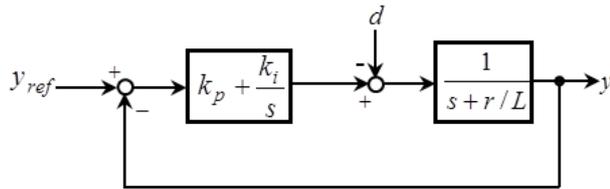


Fig. 4: Adjustment Structure of the PI Type.

In control, we obtain the following controller, depending on the damping coefficient ζ and the frequency ω_N :

$$\begin{cases} k_p = 2\zeta\omega_N - a \\ k_i = \omega_N^2 \end{cases} \quad (10)$$

There are two well-known empirical approaches proposed by Ziegler and Tit for determining the optimal parameters of the PI controller Table 1.

Table 1: Optimal Parameters of the PI Controller.

Type of regulator	K_p	T_i	K_d
PI	$0.45K_{cr}$	$0.83 P_{cr}$	0

The method Ziegler-Nichols (Ziegler and Nichols, 1942) used in the present article is based on a trial conducted in closed loop with a simple analogy proportional controller. The gain K_p of the regulator is gradually increased until the stability limit, which is characterized by a steady oscillation. Based on the results obtained, the parameters of the PI controller given by TABLE 2:

Table 2: Parameters PI controller in our system

Parameters	K_i	ω_0	K_p	ζ
Valeas	20.000	314.156	0.45	0.200

3.1.1. Performance evaluation

Simulation are performed with a Pentium-PC under MATLAB/Simulink software program. The transmission line and the UPFC (two inverters) system are implemented with Simulink blocks.

For each of the control systems, a simulation model is created which includes the required PWM. The parameters of the simulation model are selected to be equal to the parameters of a laboratory UPFC model (Bouanane and al 2013), which are listed in TABLE 3.

Table 3: The Parameters of the Laboratory UPFC Model

$V_t = 220 \text{ V}$	$R_p = 0.4 \text{ } \Omega$
$V_s = 220 \text{ V}$ $V_{dc}^* = 280 \text{ V}$	$L_p = 10 \text{ H}$
$C = 2 \text{ mF}$	$R = 0.8 \text{ } \Omega$
	$L = 10 \text{ H}$

3.1.2. Simulation results of system UPFC with PI decoupling control

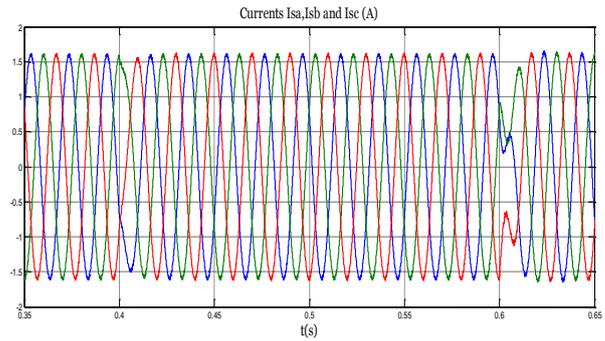


Fig. 5: Currents Waveforms I_{sa} , I_{sb} and I_{sc} (A).

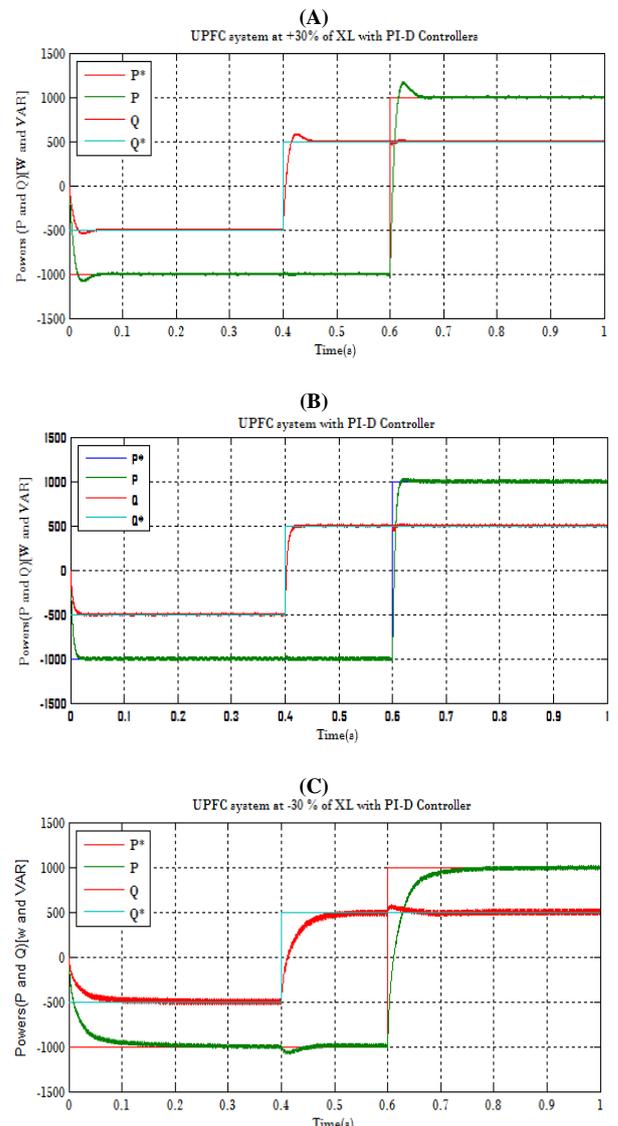


Fig. 6: Powers Responses Our System with PI-D: (A), at +30% of XL, (B), At XL and (C), at -30% of XL

The test robustness is observed that the 0.4 s and 0.6 s moments cause an almost zero variation considered as a disturbance of active and reactive power Fig 6. Due to the interaction between the two powers. The control system has a fast-dynamical response and the same in DC voltage fig7.

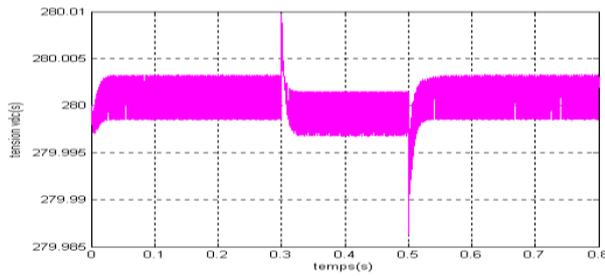


Fig. 7: DC Voltage.

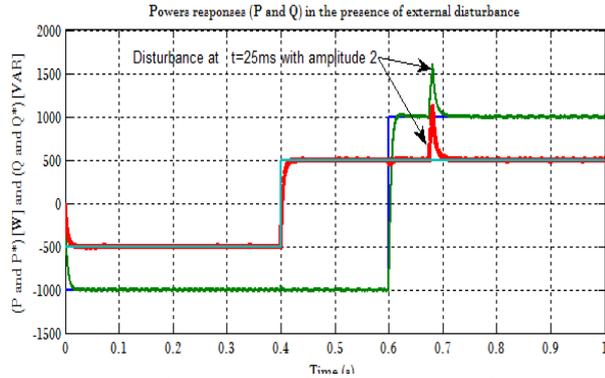


Fig. 8: System Response in the Presence of External Disturbance.

By introducing perturbation Fig. 8 duration of 25 ms and amplitude 1.5 to test again stability of our system. As can be seen, the controller (PI-D) rejected the external perturbation quite rapidly.

3.2. Neural adaptive control

Currently the adaptive control is of a great importance in the field of control. This command is dominant in systems that present uncertainties, structural disturbances and changes in the environment. The main object of the adaptive control is the synthesis of the act of adaptation, for the automatic adjustment in real time of the regulators of the control loops in order to achieve or maintain certain level of performance when the parameters of the process to order are difficult to determine or vary with time. The interest of the adaptive control appears mainly at the level of disturbance parametric, that is to say are acting on the characteristics of the process to order, disturbance, act on the variables to regulate or to order. The interest of the adaptive control appears mainly at the level of disturbance parametric, that is to say are acting on the characteristics of the process to order, disturbance, act on the variables to regulate or to order. Finally, the combination of the adaptive control with other types of conventional commands of the automatic has borne fruit and has been the source of many jobs. The adaptive laws implanted in the ideal case could lead to instability in the case of external disturbances bounded.

In this article we present the Adjustment method proposed for the UPFC, favoring the classical approach based on neurons networks. Neural Network is trained by adaptive learning (Reaz and al, 2004; Xie and al, 2006; Bouanane and al, 2013), the network ‘learns’ how to do tasks, perform functions based on the data given for training. The knowledge learned during training is stored in the synaptic weights. The standard Neural Network structures (feed forward and recurrent) are both used to model the UPFC system. The main task of this paper is to design a neural network controller which keeps the UPFC system stabilized. Elman’s network (Xiang and al, 2003) said hidden layer network is a recurrent network, thus better suited for modeling dynamic systems.

His choice in the neural control by state feedback, is justified by its role, this network can be interpreted as a state space model nonlinear. Learning by back propagation algorithm standard is the law used for identification of the UPFC.

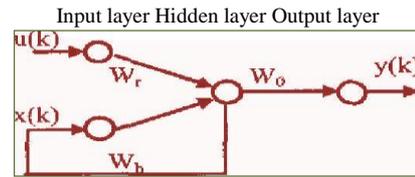


Fig. 9: Structure of the Elman Network.

3.2.1. Neural adaptive control by state space UPFC system with ERNN (NACSSS-ERNN)

The integration of these two approaches (neural adaptive control) in a single hybrid structure, that each benefit from the other, but to change the dynamic behavior of the UPFC system was added against a reaction calculated from the state vector (state space) Fig. 7.

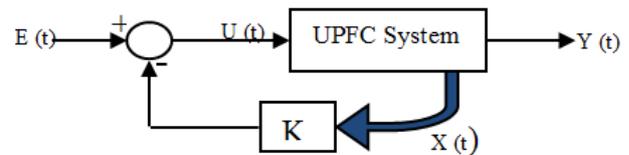


Fig. 10: Diagram of A UPFC Control by State Feedback.

The state feedback control is to consider the process model in the form of an equation of state:

$$X^*(t) = A x(t) + B U(t) \tag{11}$$

And observation equation:

$$Y(t) = C x(t) + D U(t) \tag{12}$$

Where $u(t)$ is the control vector, $x(t)$ the state vector, and $y(t)$ the output vector of dimension for a discrete system to the sampling process parameters T_e at times of T_e sample k are formalized as follows:

$$X(t + 1) = A_d X(t) + B U_d(t) \tag{13}$$

$$Y(t) = C_d x(t) + D_d U(t) \tag{14}$$

The system is of order 1, so it requires a single state variable x . this state variable represents the output of an integrator as shown in Fig.

$$x(t) = y(t) \quad x^*(t) = y^*(t)$$

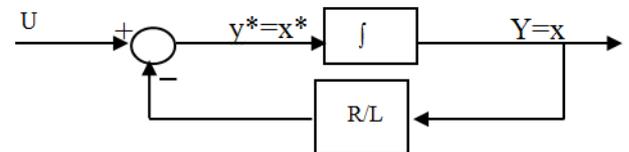


Fig. 11: Block Diagram of the State Representation of the UPFC.

The transfer function $G(s) = Y(s)/U(s)$ of our process UPFC can be written as:

$$G(s) = \frac{1}{s + r/L} \tag{15}$$

We deduce the equations of state representation of the UPFC:

$$\begin{cases} \dot{x}^* = -\left(\frac{r}{L}\right)x + u \\ y = x \end{cases} \tag{16}$$

With: $U(t) = e(t) - k x(t)$

$$\text{Let: } X(t+1) = [A_d - K B_d] x(t) + B_d e(t) \quad (17)$$

$$Y(t) = C_d x(t) \quad (18)$$

The dynamics of the process corrected by state space is presented based on the characteristic equation of the matrix $[A_d - B_d K]$, where K is the matrix state space-controlled process. Our system is described in matrix form in the state space:

Where:
$$\begin{cases} \dot{x}^* = Ax + Bu \\ y = Cx + D u \end{cases} \quad (19)$$

$$\left\{ \begin{array}{l} A = \begin{bmatrix} -\frac{r}{L} & \omega \\ -\omega & -\frac{r}{L} \end{bmatrix} \quad B = \begin{bmatrix} -\frac{1}{L} & 0 \\ 0 & -\frac{1}{L} \end{bmatrix} \quad C = \begin{bmatrix} 1 & 0 \\ 0 & 1 \end{bmatrix} \quad D = \begin{bmatrix} 0 & 0 \\ 0 & 0 \end{bmatrix} \\ u = \begin{bmatrix} v_{cd} \\ v_{cq} \end{bmatrix} \quad y = \begin{bmatrix} i_{sd} \\ i_{sq} \end{bmatrix} \quad x = [i_{sd} \quad i_{sq}]^T \end{array} \right. \quad (20)$$

3.2.1.1. UPFC system identification USING ERNN (NEWELM)

The identification makes it possible to obtain a mathematical model that represents as faithfully as possible the dynamic behaviour of the process (Narendra and al, 1990; Delgado and al, 1995). A process identified will then be characterized by the structure of the model, of its order and by the values of the Settings. It is therefore, a corollary of the process simulation for which one uses a model and a set of coefficients in order to predict the response of the system.

The figure shows the network Elman consisting of three layers: a layer of entry, hidden layer and a layer of output. The layers of entry and exit interfere with the outside environment, which is not the case for the intermediate layer called hidden layer. In this diagram, the entry of the network is the command $U(t)$ and its output is $Y(t)$. The vector of state $X(t)$ from the hidden layer is injected into the input layer.

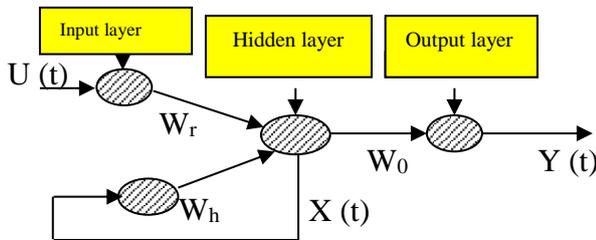


Fig. 12: Structure of the NEWELM.

The state vector $X(t)$ from the hidden layer is injected into the input layer. We deduce the following equations:

$$X(t) = W_r X(t-1) + W_h U(t-1) \quad (21)$$

$$Y(t) = W_0 X(t) \quad (22)$$

Where, W_h ; W_r et W_0 are the weight matrices. Equations are standard descriptions of the state space of dynamical systems. The order of the system depends on the number of states equals the number of hidden layers. When an input-output data is presented to the network at iteration k squared error at the output of the network is defined as:

$$E_t = (y_d(t) - y(t))^2 \quad (23)$$

For the whole training data $u(t)$, $y_d(t)$ de $t = 1, 2 \dots N$, the summed squared errors are:

$$E = \sum_{t=1}^N E_t \quad (24)$$

The weights are modified at each time step for W_0 :

$$\frac{\partial E_t}{\partial W_0} = (y_d(t) - y(t)) \frac{\partial y(t)}{\partial W_0}$$

$$\frac{\partial E_t}{\partial W_0} = (y_d(t) - y(t)) \cdot X^T(t) \quad (25)$$

For W_h et W_r ,

$$\frac{\partial E_t}{\partial W_h} = -\frac{\partial E_t}{\partial y(t)} \cdot \frac{\partial y(t)}{\partial x(t)} \cdot \frac{\partial x(t)}{\partial W_h}$$

$$\frac{\partial E_t}{\partial W_h} = -(y_d(t) - y(t)) \cdot W_0^T \cdot u(t) \quad (26)$$

$$\frac{\partial E_t}{\partial W_r^i} = -\frac{\partial E_t}{\partial y(t)} \cdot \frac{\partial y(t)}{\partial x_i(t)} \cdot \frac{\partial x_i(t)}{\partial W_r^i}$$

$$\frac{\partial E_t}{\partial W_r^i} = -(y_d(t) - y(t)) \cdot W_0^i \cdot \frac{\partial x_i(t)}{\partial W_r^i} \quad (27)$$

The latter we obtain:

$$\frac{\partial x_i}{\partial W_r^i} = X^T(t-1) + W_r^i \frac{\partial x_i(t-1)}{\partial W_r^i} \quad (28)$$

Equation shows that there is a dynamic trace of the gradient. This is similar to back propagation through time. Because the general expression for weight modification in the gradient descent method is:

$$\Delta W = -\eta \frac{\partial E_t}{\partial W} \quad (29)$$

The dynamic back propagation algorithm used to identify a state space model of the UPFC for NEWELM (Elman network) can be summarized as follows:

$$\Delta W_0 = -\eta E(t) X^T(t) \quad (30)$$

$$\Delta W_h = \eta E(t) \cdot W_0^T(t) u(t) \quad (31)$$

$$\Delta W_r^i = \eta E(t) \cdot W_0^i(t) \left(\frac{\partial x_i(t)}{\partial W_r^i} \right) \quad (32)$$

If the dependence of $X(t-1)$ on W_r is ignored, the above algorithm degrees' is the standard back propagation algorithm:

$$\frac{\partial x_i(t)}{\partial W_r^i} = X^T(t) = X^T(t-1) \quad (33)$$

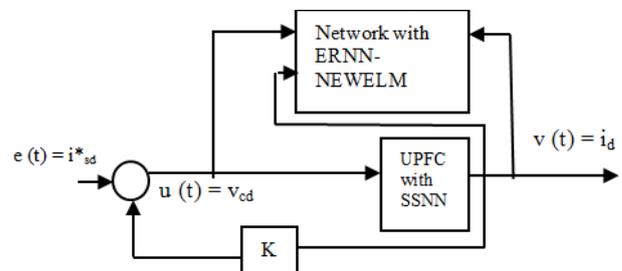


Fig. 13: UPFC System Presentation with State Space and (ERNN-NEWELM).

Note that the performance of the identification is better when the input signal is sufficiently high in frequency to excite the different modes of process. The three weights W_0 , W_r and W_h which are respectively the matrices of the equation of state of the process system (UPFC) $[C, A$ and $B]$ became stable after a rough time $t = 0.3s$ and several iterations fig. 9. NB. For the NEWELM is assumed through the vector is zero ($D = 0$).

3.2.1.2. Estimation of the parameters

The input used ladder type is considered for identification systems (M. I. Marei, 2012). It is obvious that the input is better than other (ramp, sinusoid) from the point of view of identification. In order to allow an identification by inputs allowing to excite the maximum of modes of the system without disturbing its normal operation too much, if one wants to draw a lot of information, in particular to excite it in all the interesting frequency band, one uses in general a slot-like variation of pseudo-random binary sequence (SBPA) superimposed on the wanted signal (PRBS).

The design of a system of efficient regulation and robust requires knowing the dynamic model of the process, which describes the relationship between the variations of the command and the variations of the measure. The dynamic model can be determined by direct identification.

- The classic method type "Response Level" requires signals of excitation of large amplitudes; its accuracy is reduced, and does not allow the validation of the model.
- The current methods with recursive identification algorithms offer better accuracy and operate in open or closed loop mode with excitation signals of very low amplitude (0.5 to 5% of the pseudo random binary sequence op (PRBS), and in frequency.

The Pseudo Random Binary Sequence (PRBS) is a signal consisting of rectangular pulses modulated randomly in length, which approximate a white noise discreet, therefore rich in frequency and average value of zero, not amending the operating point of the process. Easy to generate; it is commonly used in the identification procedures. Posed on useful signal.

So, in this article we used for the identification of the parameters of the Elman network system with three layers. Note that the performance of the identification is better when the input signal is sufficiently rich in frequencies to excite the different modes of process. To obtain its results, a pseudo random binary sequence (PRBS) is used as the excitation signal and are of the estates of rectangular pulses modulated in width, which are approximate to a white noise discrete which have a rich content of frequencies.

For the simulation it was chosen:

- Network Elman (NEWELM) to three layers [Entry, hidden and output] is respectively [vector command, the vector of state and output vector]
- A rich signal of frequency pseudorandom binary sequence is of languor in 1023 and of amplitude 1V.
- A PRBS signal fig 14. Is input to system to provide reasonable convergence of the neural network weights for the controller to start with.

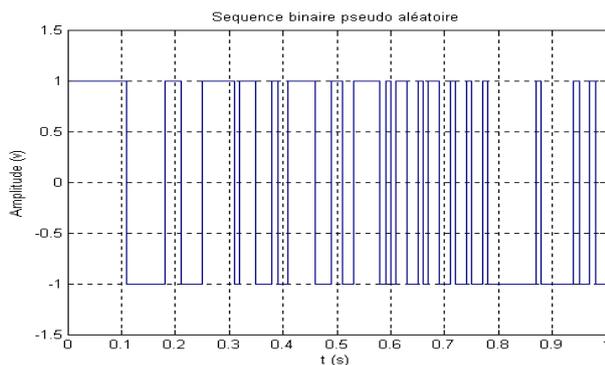


Fig. 14: PRBS Signal and Changing Weights.

There is after the application of pseudorandom binary sequence (PRBS) signal that the pace of three weights w_0 , w_1 and w_2 who are respectively the matrices of the equation of state of the process (UPFC system). [C, A and B] are become stable after an approximate time $t=0.3s$ and several iterations and [D] equal to zero for the NEWELM figure15.

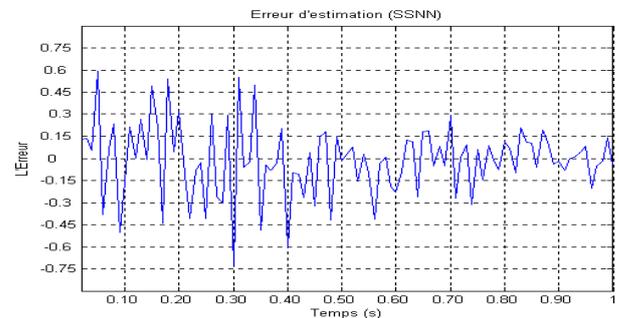


Fig. 15: Estimation Error.

In Elman network learning, the tasks of identification, synthesis and correction are done one after the other, where the correction of the numerical values of the parameters is done recursively so the error of estimation puts about one second ($t = 1s$) to converge to zero Fig. 15.

3.2.2. Neural adaptive control by internal model of a UPFC system (NACIMS)

Several techniques can be envisaged in order to improve the performance. In this work, we use the command by internal model, which belongs to the family of commands in a closed loop (feedback). Its principle is call to a model of the system and has the property to operate in quasi open loop as long as the system and their models are identical, which reduces the risks of instability encountered in the technical standards of counter-reaction. This solution can be used on any architecture or technology of the chain because the only elements to be added are a couple and a demodulator to the issuance to retrieve information on the distortions introduced. In order to assess the performance of this technique, we have applied in simulation on our system UPFC.

3.2.2.1. Internal model control

Figure 16 represents the basic scheme of IMC. For reasons of simplicity, it illustrates the general principle on a linear system in the field of Laplace knowing that this representation can be extended to the discrete domain.

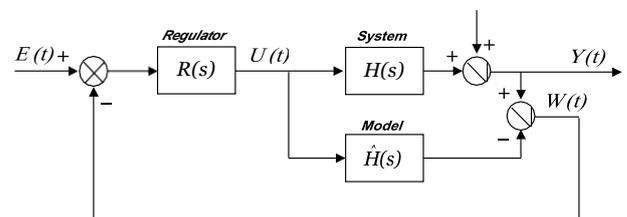


Fig. 16: Basic Scheme of IMC.

In this figure, we find the main elements of a feedback loop:

The system $H(s)$, output $y(t)$,

- The model of the $\hat{H}(s)$ system, obtained by prior identification of the system,
- The corrector $R(s)$,
- The set point or the excitation $e(t)$,
- A disturbance $d(t)$.

The study of the structure makes it possible to establish the following operating equation, linking the output Y to the input E and the perturbation D :

$$Y(s) = \frac{R(s).H(s)}{1+R(s).(H(s)-\hat{H}(s))}.E(s) + \frac{1-R(s).\hat{H}(s)}{1+R(s).(H(s)-\hat{H}(s))}.D(s) \quad (34)$$

The error of characterization (or modeling) the system that represents the difference between the system and its model is represented by the term:

$$\Delta H(s) = H(s) - \hat{H}(s) \quad (35)$$

The errors signal $w(t)$ rebuilt the disturbance $D(t)$ and the error of characterization following the command $u(t)$:

$$W(s) = \Delta H(s).U(s) + D(s) \quad (36)$$

So, we can say that the stability of the whole when $R(s)$ and $\hat{H}(s)$ are stable

For an ideal model $\hat{H}(s) = H(s)$ and $R(s) = \hat{H}(s)^{-1}$ a perfect pursuit of trajectory

$$w(t) = e(t), \forall d(t)$$

An online estimate of unmeasured disturbances

$$\tilde{d}(t) = d(t) \quad (37)$$

3.2.2.2. Neural inverse model control design

It is quite obvious that this excludes many cases, and thus the effective implementation of the IMC structure goes through techniques which are in two general principles:

- Minimize the sensitivity of the IMC structure for maximum disturbance rejection.
- Maximizing the complementary sensitivity for a better pursuit.

In the basic principle of the internal model control, the closer the model is to reality the more the structure approaches an open-loop structure. A closed loop type corrector can therefore compensate for this handicap while enlarging the class of systems for which the structure is applicable. On the other hand, the gap between the actual system and its behavioral model may be due to multiple reasons, so it is more reasonable to consider this signal as exogenous to the control. The structure of Figure 16. is modified as shown in Figure 17 (Alf Isaksson,1999).

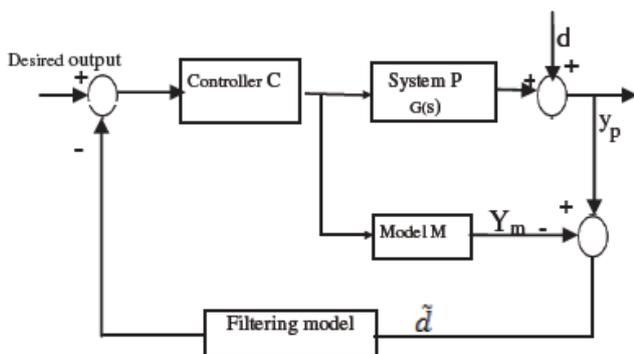


Fig. 17: Block Diagram of IMC with Input Disturbance.

The low-pass filter (Filtering model), obviously has an impact on the behavior of the closed-loop system; on the model-following as well as on the disturbance rejection ability.

The model M is determined by the Widrow-Hoff learning law (Widrow and al, 1990). The training of the network consists in modifying, with each step, the weights and bias in order to minimize the quadratic errors at output by using the law of Widrow-Hoff. With each step of training, the error at output is calculated as the difference between the required target t and the output y of the network. The quantity to be minimized, with each step of training k , is the variance of the error at the output of the network.

$$E_k = e_k^T e_k = \frac{1}{2} (t_k^T t_k + y_k^T y_k - 2y_k^T t_k) \quad (38)$$

T_e : The sampling time is equal to 1ms. This time will be maintained throughout this study.

The estimation of output and the error are calculated by:

$$z(k) = [-y(k-1) \quad u(k) \quad u(k-1)] \begin{bmatrix} w_1 \\ w_2 \\ w_3 \end{bmatrix} + b_1; e(k) = y(k) - z(k) \quad (39)$$

The learning of the network of neuron is to modify, at each sampling, the weight and bias (estimation of parameters) in order to minimize the quadratic criterion of the squares of the errors in the output.

The inverse model controller $y(t)$ is given by the following equation:

$$y(t) = \frac{b_1 + b_2 z^{-1}}{1 + b_2 z^{-1}} u(t-1) \quad (40)$$

Where

$$\hat{u}(t) = \frac{1}{b_1} y(t) + \frac{a_1}{b_1} y(t-1) - \frac{b_2}{b_1} u(t-2) \quad (41)$$

So, the weights and the bias fig. 18 are calculated as follows:

$$w_1 = \frac{1}{b_1}, w_2 = \frac{a_1}{b_1} \text{ and } w_3 = \frac{b_2}{b_1}$$

The control law is described by:


$$u(t) = w_c \varphi$$

With

$$w_c = [w_1 \quad w_2 \quad w_3]$$

And

$$\varphi = [r(t) \quad y(t-1) \quad u(t-2)] \quad (42)$$

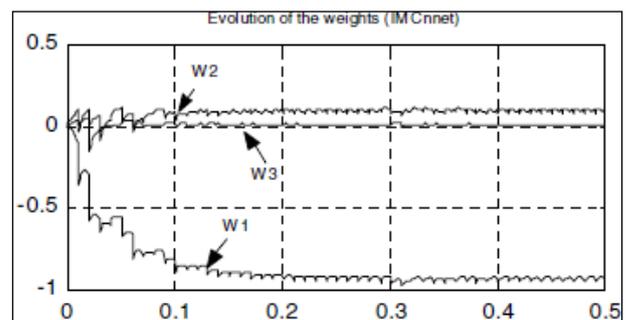

Evolution of the Weights NACIMS

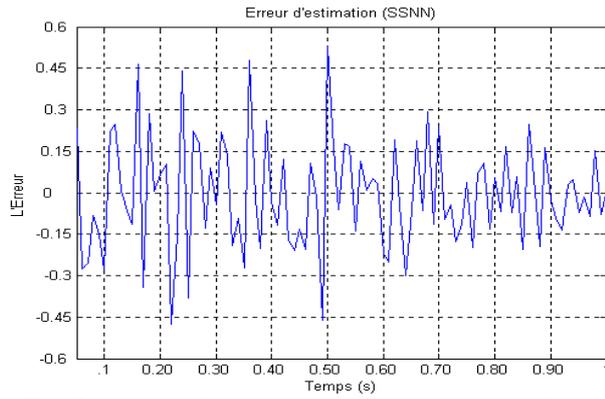


Fig. 18: Evolution of the Weights and Estimation Error (NACIM).

3.3. Simulation with NACSS-NEWELM

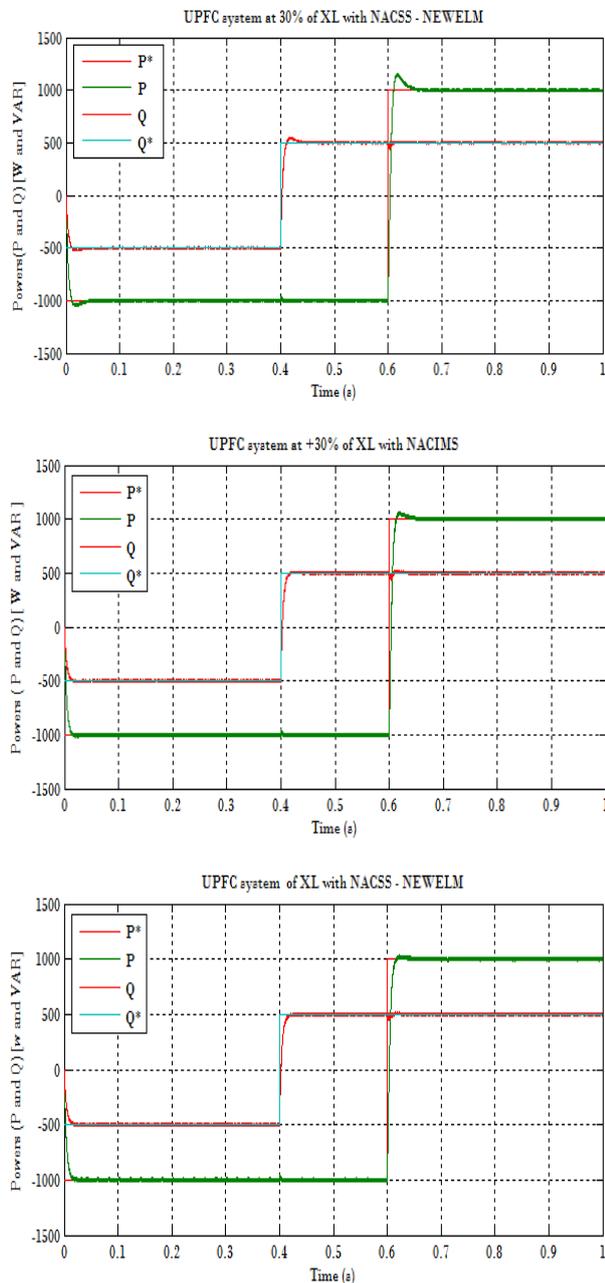


Fig. 19: Powers (P and Q) of the Control System with (NACSS-NEWELM) At $\pm 30\%$ of XL.

3.4. Simulation with NACIMS

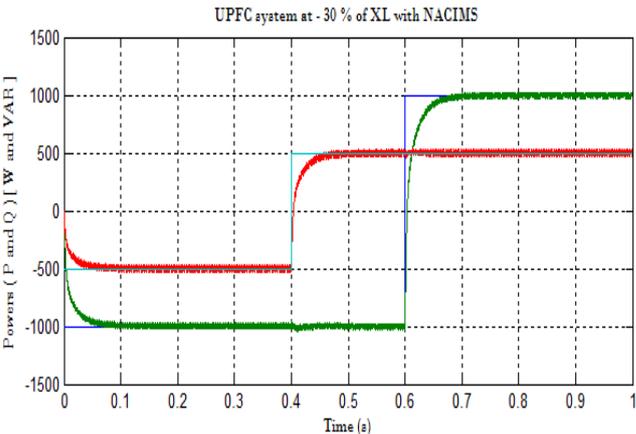
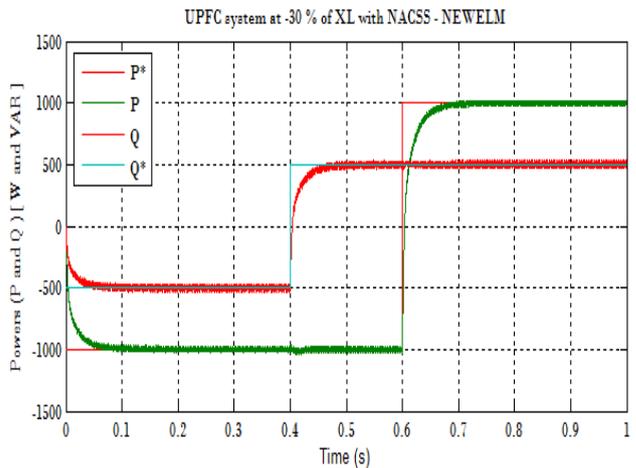
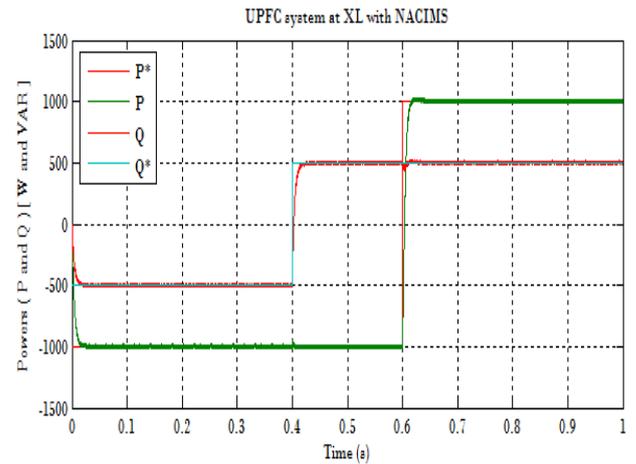


Fig. 20: Powers (P and Q) of the Control System with (NACIMS) at $\pm 30\%$ of XL.

4. Comparative simulation studies between NACSS-NEWELM and NACIMS

Adaptive Neural Feedback Control (ANFC) is a hybrid control that was allowed to control any variation in monitoring, regulation or stability. The results of the simulation showed the strength of our neural adaptive controller (NAC). We can say that the decoupled PI regulator would be ideal for the UPFC system control if the $\pm 30\%$ variation of the reactance did not degrade its dynamic performance, as pointed out in this article. The process model is never perfect.

The results of this analysis of the two controls by neural networks at $\pm 30\%$ of XL fig.19 are summarized in the following points:

- All control strategies indicate that the proposed regulators have better dynamic performance and are much more robust than the traditional PI controller. They seem to be very high-performance dynamic regulators.
- Thanks to the generalization capacity of network neurons, the use of a neural identification regulator allows an improvement in the dynamic performance of the regulator approached. It has even been demonstrated by simulation that a neural identification regulator can solve the problem of the incapacity of parametric variations regulator PI of the line.

5. Conclusion

In this article, our UPFC system based on three robust control methods has been proposed [(PI-D), (NEWELM and NIMC) based neural adaptive control]. These control strategies introduce enough flexibility to set the desired level of stability and performance. Practical constraints were considered by introducing appropriate uncertainties. The methods above have been applied to a typical test of a single-phase power system bridge. Simulation results showed that designed regulators were able to ensure a robust stability and performance a wide range of uncertainty of parameters of transmission. But line orders two hybrid (NACSSS-ERNN and NACIMS) in case of modification of the parameters of the system and an excellent ability to improve the stability of the system under small disturbances.

References

- [1] Alf Isaksson "Model based control design Supplied as supplement to course book in Automatic Control Basic" course (Reglerteknik AK) September, 1999.
- [2] B.A. Renz, A. Keri, A.S. Mehraben, C. Schauder, E. Stacey, I. Kovalsky, L. Gyugyi, and A. Edris, 1999, "AEP Unified Power Flow Controller Performance", IEEE Trans. on Power Delivery, 14(4), pp. 1374-1381. <https://doi.org/10.1109/61.796231>.
- [3] Bouanane A., Chaker A. and Amara M. "adaptive control with SSNN of UPFC system for compensation of active and reactive power". Res J. Appl. Sci. Eng. Technol. Vol 6(4):739-747, 2013. <https://doi.org/10.19026/rjaset.6.4190>.
- [4] Ch. Praing, T. Tran-Quoc, R. Feuillet, J.C Sabonnadiere, J. Nicolas, Boi K. Nguyen "Impact of FACTS devices on voltage and transient stability of a power system including long transmission lines", IEEE Transactions on Power Engineering Society. Vol. 3, pp. 1906 - 1911, 2000.
- [5] Delgado, A. and al (1995) "dynamic recurrent neural networks for system identification and control" IEE Proc. Control Theory Applications, Vol 142, n^o4, pp.307-314. <https://doi.org/10.1049/ipcta:19951873>.
- [6] H. Johal and D. Divan, "Design considerations for series-connected distributed FACTS converters", IEEE Transactions on industry applications, Vol.43, PP: 1609-1618, Nov/Dec. 2007.
- [7] Henriques, J. and A. Dourado, 1999. A hybrid neural- decoupling pole placement controller and its application. Proceeding of 5th European Control Conference (ECC99). Karlsruhe, Germany.
- [8] Hideaki Fujita, Yasuhiro Watanabe, Hirofumi Akagi, "Control and Analysis of a Unified Power Flow Controller", IEEE TRANSACTIONS ON POWER ELECTRONICS, VOL. 14, NO. 6 November 1999, pp.1021-1027. <https://doi.org/10.1109/63.803395>.
- [9] J. Bian, D.G. Ramey, R.J. Nelson, and A. Edris, 1997, "A Study of Equipment Sizes and Constraints for a Unified Power Flow Controller", IEEE Trans. on Power Delivery, 12(3), pp. 1385-1391. <https://doi.org/10.1109/61.637019>.
- [10] Kannan. S, Shesha Jayaram and M.M.A.Salama. (2007) 'Real and Reactive Power Coordination for a Unified Power Flow Controller' IEEE Transactions on Power Systems, 2007, vol.19. No.3, pp. 1454 - 1461.
- [11] L. Gyugyi 'Unified Power Flow Control concept for Flexible AC Transmission System' IEE Proceedings C - Generation, Transmission and Distribution (Volume: 139, Issue: 4, July 1992).
- [12] L. Gyugyi, C.D. Schauder, S.I. Williams, T.R. Reitman, D.R. Torgerson, and A. Edris, 1995, "The Unified Power Flow Controller: A new approach to power transmission control", IEEE Trans. on Power Delivery, 10(2), pp. 1085-1097. <https://doi.org/10.1109/61.400878>.
- [13] L. Gyugyi, 1994, "Dynamic Compensation of AC Transmission Line by Solid State Synchronous Voltage Sources," IEEE Transactions on Power Delivery, 9(22), pp. 904-911. <https://doi.org/10.1109/61.296273>.
- [14] M. I. Marei, "A unified control strategy based on phase angle estimation for matrix converter interface system," IEEE Systems Journal, vol. 6, no. 2, pp. 278-286, 2012. <https://doi.org/10.1109/JSYST.2011.2163010>.
- [15] Narain, G.H. and G. Laszlo, 1999. Understanding FACTS: Concepts and Technology of Flexible AC Transmission Systems. Wiley-IEEE Press Marketing, pp: 297-352; 407-424.
- [16] Narendra K., Parthasarathy K. (1990) "identification and control of dynamical systems using neural networks", IEEE Trans. Neural Networks, Vol 1, pp4-27. <https://doi.org/10.1109/72.80202>.
- [17] Nguyen, D. and B. Widrow, 1990. Neural networks for self-learning control systems. IEEE Control Syst. Mag., 10(3): 18-23. <https://doi.org/10.1109/37.55119>.
- [18] P. Jagtap and N. Sharma, "Modelling and Application of Unified Power Flow Controller (UPFC)," *Emerging Trends in Engineering & Technology, International Conference on (ICETET)*, Goa, India, 2010, pp. 350-355.
- [19] Papic, I., P. Zunko, D. Povh and M. Weinhold, 1997. Basic control of unified power flow controller. IEEE T. Power Syst., 12(4): 1734-1739. <https://doi.org/10.1109/59.627884>.
- [20] R. Mohan Mathur and R. K. Varma. Thyristor-based FACTS Controllers for Electrical Transmission Systems, IEEE Series on Power Engineering, US, 2002. <https://doi.org/10.1109/9780470546680>.
- [21] Reaz, M.B.I., Wei, L.S.: Adaptive linear neural network Alter for fetal ECG extraction. In: The International Conference on Intelligent Sensing and Information Processing. (2004) pp.321-324.
- [22] S Kannan Real & Reactive power coordination for UPFC, IEEE Transaction on power system vol19 n03 Aug 2004.
- [23] Sen, K.K. 1998, "SSSC - Static Synchronous Series Compensator: Theory, Modeling and Application", IEEE Trans. on Power Delivery, 13(1), pp. 241-246. <https://doi.org/10.1109/61.660884>.
- [24] Sen, K.K. and A.J.F. Keri, 2003. Comparison of field results and digital simulation results of voltage-sourced converter-based FACTS controllers. IEEE T. Power Deliver. 18: 300-306. <https://doi.org/10.1109/TPWRD.2002.804012>.
- [25] Widrow, B., Lehr, M. A. "30 years of adaptive neural networks: Perceptions, Madeline and backpropagation". Proc. of IEEE 78 (1990) 1415-1442. <https://doi.org/10.1109/5.58323>.
- [26] Xiang, L., C. Guanrong, C. Zengqian and Z. Yuan, 2002. Chaotifying linear Elman networks. IEEE T. Neural Networ, 13(5): 1193-1199. <https://doi.org/10.1109/TNN.2002.1031950>.
- [27] Xie, J.X., C.T. Cheng, K.W. Chau and Y.Z. Pei, 2006. A hybrid adaptive time-delay neural network model for multi-step-ahead prediction of sunspot activity. Int. J. Environ. Poll. 28: 364-381. <https://doi.org/10.1504/IJEP.2006.011217>.
- [28] Zhengyu, H., N. Yinxin, C.M. Shen, F.F. Wu, C. Shousun and Z. Baolin, 2000. Application of unified power flow controller in interconnected power systems-modelling, interface, control strategy and case study. IEEE T. Power Syst., 15: 817-824. <https://doi.org/10.1109/59.867179>.
- [29] Ziegler, J.G. and N.B. Nichols, 1942. Optimum settings for automatic controllers. Trans. ASME, 64: 759-768.