International Journal of Engineering & Technology, 7 (4.5) (2018) 126-129

International Journal of Engineering & Technology

Website: www.sciencepubco.com/index.php/IJET

Research paper

Comparison and Analysis of Magnetizing Inrush and Fault Condition for Power Transformer

Mudita Banerjee[1]*, Dr. Anita Khosla[2]

[1]*Researcher, EEE Department, Manav Rachna International University, Faridabad, Haryana, India*
[2]*Professor, EEE Department, Manav Rachna International University, Faridabad, Haryana, India*
**Corresponding author E-mail mmmudita@gmail.com*

Abstract

This paper presents the second harmonics present in the primary current of a power transformer at different conditions using Fast Fourier Transform and Total Harmonic Distortion techniques to analyze the inrush condition and to distinguish it with fault condition of a power transformer. Result shows that the 2nd harmonic content is pre-dominant in inrush condition of primary current of the power transformer. It is observed that there are significant differences amongst the parameters found during inrush condition, normal condition and internal fault condition which are useful in the identification of magnetizing inrush current of power transformer. The simulation is done in MATLAB/SIMULINK.

Keywords: *Fault current; FFT; Inrush current; Power Transformer; Second Harmonic Component; THD.*

1. Introduction

Sometimes conventional differential relay mal-operates during initial energization of the power transformer, due to the occurrence of magnetizing inrush current. This inrush current, is a transient condition, which is drawn by the primary of the transformer whenever an unloaded transformer is switched on for the first time and instantaneous voltage is not at 90˚ angle. During this time, the magnitude of the flux is higher than that of the flux at the steady state condition. This current appears like an internal fault and it causes an unwanted switching in the circuit breaker of the transformer [1][2]. This inrush current has a high value of DC-component which is decaying with time and has large value of harmonics. The Inrush phenomenon is shown in fig. 1. The expression of flux is given by:

$$\Phi = \Phi_R + \Phi_m \cos \Theta - \Phi_m \cos (\omega t + \Theta)$$

Thus, the flux is a function of following three factors which influence the magnitude and duration of magnetizing inrush current:

- Residual flux Φ_R
- Instant of switching Θ
- Magnetic properties of core, i.e. the amount of magnetising current required to produce a given amount of flux. [2]

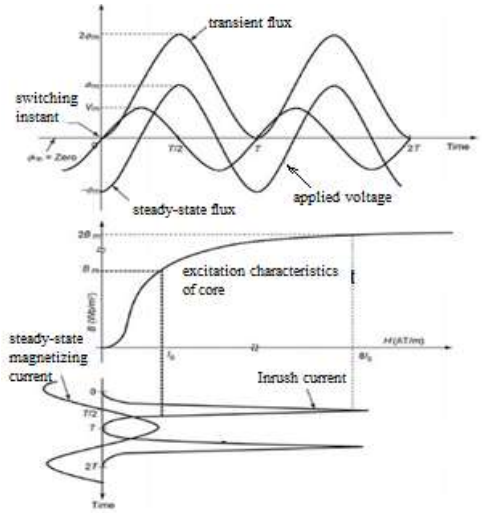


Fig. 1: Inrush phenomenon

The problems caused by inrush current are unbalance and harmonics. Other disturbances caused by inrush are: Incorrect operation and failures of electrical machines and relay systems, Irregular voltage distribution along the transformer windings, high amount of voltage drop at the power system at energization times, electrical and mechanical vibrations among the windings of the transformer. Table 1 gives harmonic content of a typical inrush waveform [6]

Table 1: Harmonic content of typical inrush current waveform

Frequency	Magnitude
Fundamental component	100 %
DC component	40 – 60 %
2nd harmonic	30 – 70 %

Copyright © 2018 Mudita Banerjee, Dr. Anita Khosla. This is an open access article distributed under the Creative Commons Attribution License, which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

3rd harmonic	10 – 30 %
4th harmonic	Less than 5 %
5th harmonic	Less than 5 %
6th harmonic	Less than 5 %
7th harmonic	Less than 5 %

From table 1, the second harmonic content is high for inrush condition than for fault current. Presence of Inrush current which is a transient condition creates a false tripping of relay. Therefore, to avoid the needless trip by magnetizing inrush current, the second harmonic component is used for blocking the relay operation [3]. It is effective, fast and simple technique to discriminate between magnetizing inrush fault current in transformers.

Since 1960, much research has been done to improve security while maintaining dependability. Randy Hamilton [4] had proposed a common restraint method to use the second harmonic information in the inrush current to secure differential protection when energizing transformers. C. L. Cheng et al [5] demonstrated an accurate model which shows the inrush current in single-phase transformers. Conditions under investigation are related to transformer loading, switch-on angles, and remanent flux.

In this paper, an attempt has been made to detect and analyze the inrush condition of a transformer. Fast Fourier Transform (FFT) is used to find out the presence of harmonics in primary current of transformer and Total Harmonic Distortion (THD) is calculated to analyze the inrush condition using MATLAB/SIMULINK environment. This analysis will be helpful to generate the tripping signal for the 3 - phase power transformer protection.

2. MATLAB Implementation

Simulation of normal condition, magnetising inrush condition and internal fault condition is performed in MATLAB/SIMULINK considering a 50 MVA, 220/11 kV, 50 Hz, 3 - phase power transformer for the assessment of magnetising inrush current. Second harmonic method is used to compare inrush and fault current for the following conditions:

1) Magnetising Inrush condition
2) Normal operating condition
3) Internal Fault condition

Condition 1: Magnetizing Inrush condition:

Figure 2 shows the block diagram for simulation of normal and inrush conditions wherein a three phase two winding 50MVA, 220/11 kV, 50 Hz power transformer is connected to three - phase source through a 3-phase circuit breaker. Primary current of 3-phase transformer have been stored in workspace after the sampling. Assuming only one transformer is to be energized and no other transformer is connected to that system.
The total simulation time for this model is considered as 0.5 second. The transformer parameters are given in table 2.

Table 2: Outline of measured Transformer

Type	3-phase, core type, two - winding transformer
Rated capacity	50 MVA
Rated voltage ratio	220/11 kV
Rated frequency (f)	50 Hz
Connection	Y-Y (neutral grounding)
Magnetization resistance (R_m)	500 Ω

For the simulation of magnetizing inrush current, the saturable core transformer is considered and residual flux is taken as zero.

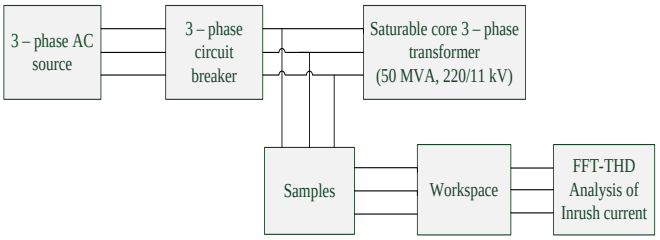


Fig. 2: MATLAB model for simulation of inrush current in transformer

Waveforms of inrush current for all three phases are shown in fig. 3. The magnitude of inrush current is 380 A, which is three times the rated current.

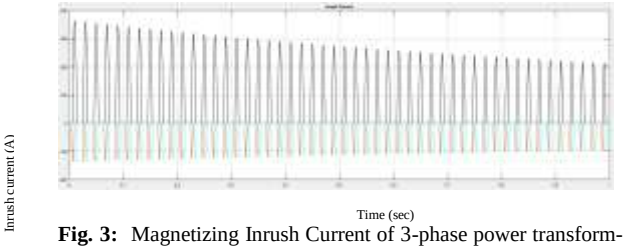


Fig. 3: Magnetizing Inrush Current of 3-phase power transformer when the switching angle is 0˚

The FFT of Inrush current of phase A is shown in fig. 4. The percentage of second harmonic with respect to fundamental frequency and total harmonic distortion of all the three phases is shown in Table 3.

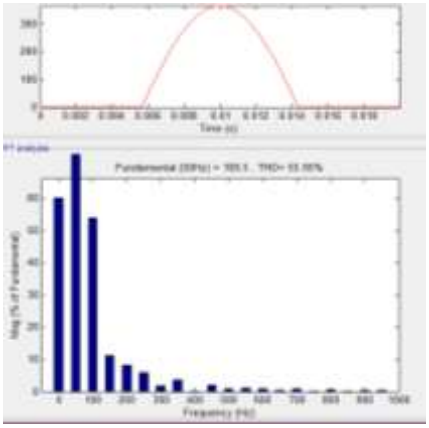


Fig. 4: FFT of Inrush current phase A

Table 3: THD and harmonic values of all three phases of Inrush current

Phase	THD	2nd harmonic	3rd harmonic	5th harmonic
Phase A	55.96	53.72	11.02	5.87
Phase B	106.85	82.22	57.64	10.74
Phase C	106.91	82.25	57.38	10.79

Condition 2: Normal operating condition:

Waveforms of primary current at normal operating condition for all the three phases are shown in fig. 5. The rated current of present considered transformer is 131 A. The FFT of rated current of phase A is shown in fig. 6.

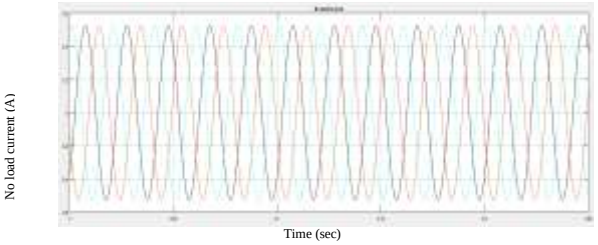


Fig. 5: Rated current waveforms of all three phases

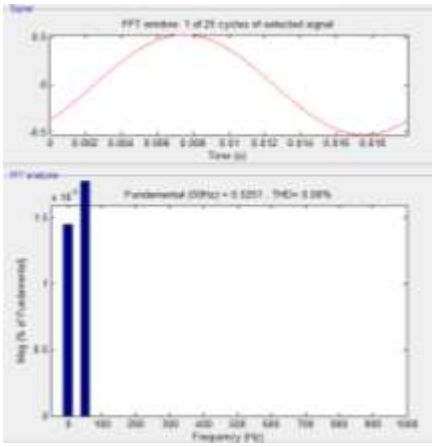


Fig. 6: FFT of normal current phase A

It is seen from fig. 6 that the THD is 0% for the normal rated current of a transformer. It is a pure sinusoidal wave.

Condition 3: Internal fault condition

MATLAB model has been prepared according to fig. 7 to simulate the internal fault condition where the same rating of three phase transformer is used. A 3 – phase to ground fault (most severe fault) is applied at the secondary side of power transformer.

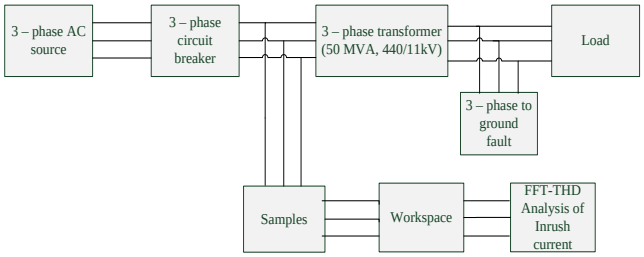


Fig. 7: MATLAB model for simulation of Internal Fault condition of power transformer

Waveforms of fault current for all the three phases are shown in fig. 8. The magnitude of fault current is 2200 A, which is about seventeen times the rated current.

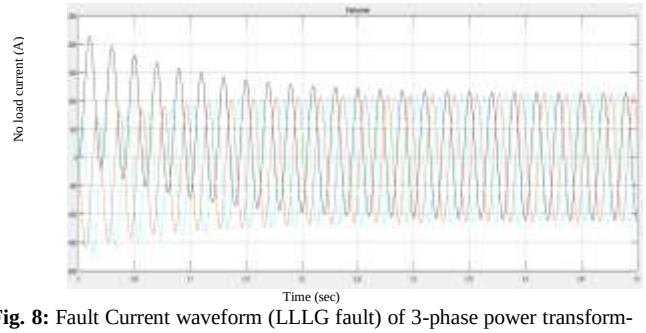


Fig. 8: Fault Current waveform (LLLG fault) of 3-phase power transformer

The FFT of fault current of phase A is shown in fig. 9. The percentage of second harmonic with respect to fundamental frequency and total harmonic distortion of all the three phases is shown in Table 4.

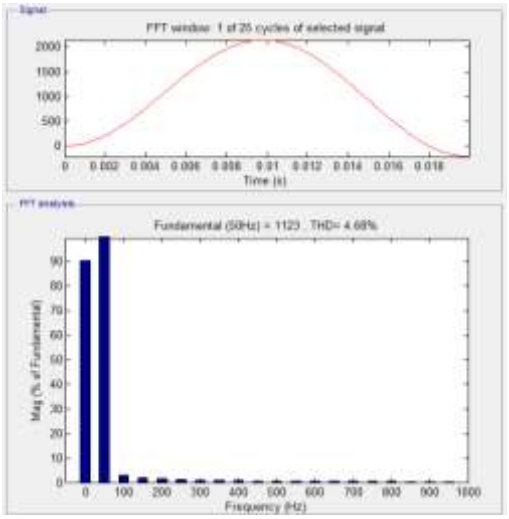


Fig. 9: FFT of fault current phase A

Table 4: THD and harmonic values of all three phases of fault current

Phase	THD	2nd harmonic	3rd harmonic	5th harmonic
Phase A	4.68	2.91	1.94	1.17
Phase B	2.09	1.25	0.84	0.5
Phase C	2.66	1.69	1.12	0.67

3. Result

This experiment is conducted on 50 MVA power transformer under fault and inrush condition. The second harmonic contents and total harmonic distortion is calculated and tabulated in table 3 and table 4. It is observed that the contents of 2nd harmonic and THD under fault condition are below 5% and on the other hand, it is about 55 % in case of Inrush current. Hence, comparison can be done between fault and inrush condition on the basis of second harmonic threshold in the primary side of power transformer. It is easier to prevent the mal operation of differential relay during magnetizing inrush condition.

4. Conclusion

In this paper, an attempt has been made using Matlab Simulink to analyze different conditions using FFT. The obtained result illustrates that the proposed Matlab model represents an appropriate action. The model gives discrimination between inrush current and fault current on the basis of second harmonic threshold. Hence it is a convenient method for inrush detection and to avoid the mal operation of differential relay during inrush. The proposed model was able to compare magnetizing inrush, fault and normal operating conditions.

References

[1] Adel Aktaibi, M.Azizur Rahman, " Digital Differential Protection of Power Transformer using Matlab", Intech Chapter 10 MATLAB-A Fundamental tool for Scientific Computing and Engineering Applications – Volume 1

[2] Y.G. Paithankar and S.R. Bhide, *Fundamentals of Power System Protection*, Prentice-Hall of lndia Private Limited, New Delhi,Second Edition 2003

[3] Kuniaki Yabe, "Power Differential Method for Discrimination between Fault and Magnetizing Inrush Current in Transformers", IEEE Transactions on Power Delivery, Vol. 12, No. 3, July 1997

[4] Randy Hamilton, "Analysis of Transformer Inrush Current and Comparison of Harmonic Restraint Methods in Transformer Protection", IEEE Transactions on Industry Applications, VOL. 49, NO. 4, July/August 2013

[5] C. L. Cheng, a C. E. Lin, b C. L. Huang b and J. C. Yeh, "A simple model for transformer inrush current calculation and harmonic analysis", Electric Power Systems Research, 24 (1992) 153-163
[6] Power System Relaying Committee of the IEEE Power Engineering Society, "IEEE Guide for Protecting Power Transformers", Approved 31 January 2008 IEEE-SA Standards Board
[7] Yundong Song, Hongde Jia, Xiaofeng Xu, Li Yu, "Simulation Analysis of Inrush Current of Three Phase Transformer Based on MATLAB", IEEE 29th Chinese Control and Decision Conference (CCDC)2017
[8] Li-Cheng Wu, Chih-Wen Liu, Shih-En Chien, Ching Shan Chen, "The Effect of Inrush Current on Transformer Protection", Power Symposium, 2006. NAPS 2006. 38th North American
[9] Marinko Stojkov and Zeljko Spoljaric, "New Possibilities in Inrush Current Phenomena Analysis", J Elec Electron 2012, Electrical & Electronics Vol 1 Issue 3